BEFORE THE

WASHINGTON UTILITIES & TRANSPORTATION COMMISSION

DOCKET NO. UE-01_____

EXHIBIT NO. _____ (KON-2)

WITNESS: KELLY O. NORWOOD, AVISTA CORP

AVISTA UTILITIES

2001 Avista System and Mid-Columbia Hydro Generation Below Normal vs. "Critical Water"

(aMW by Month)

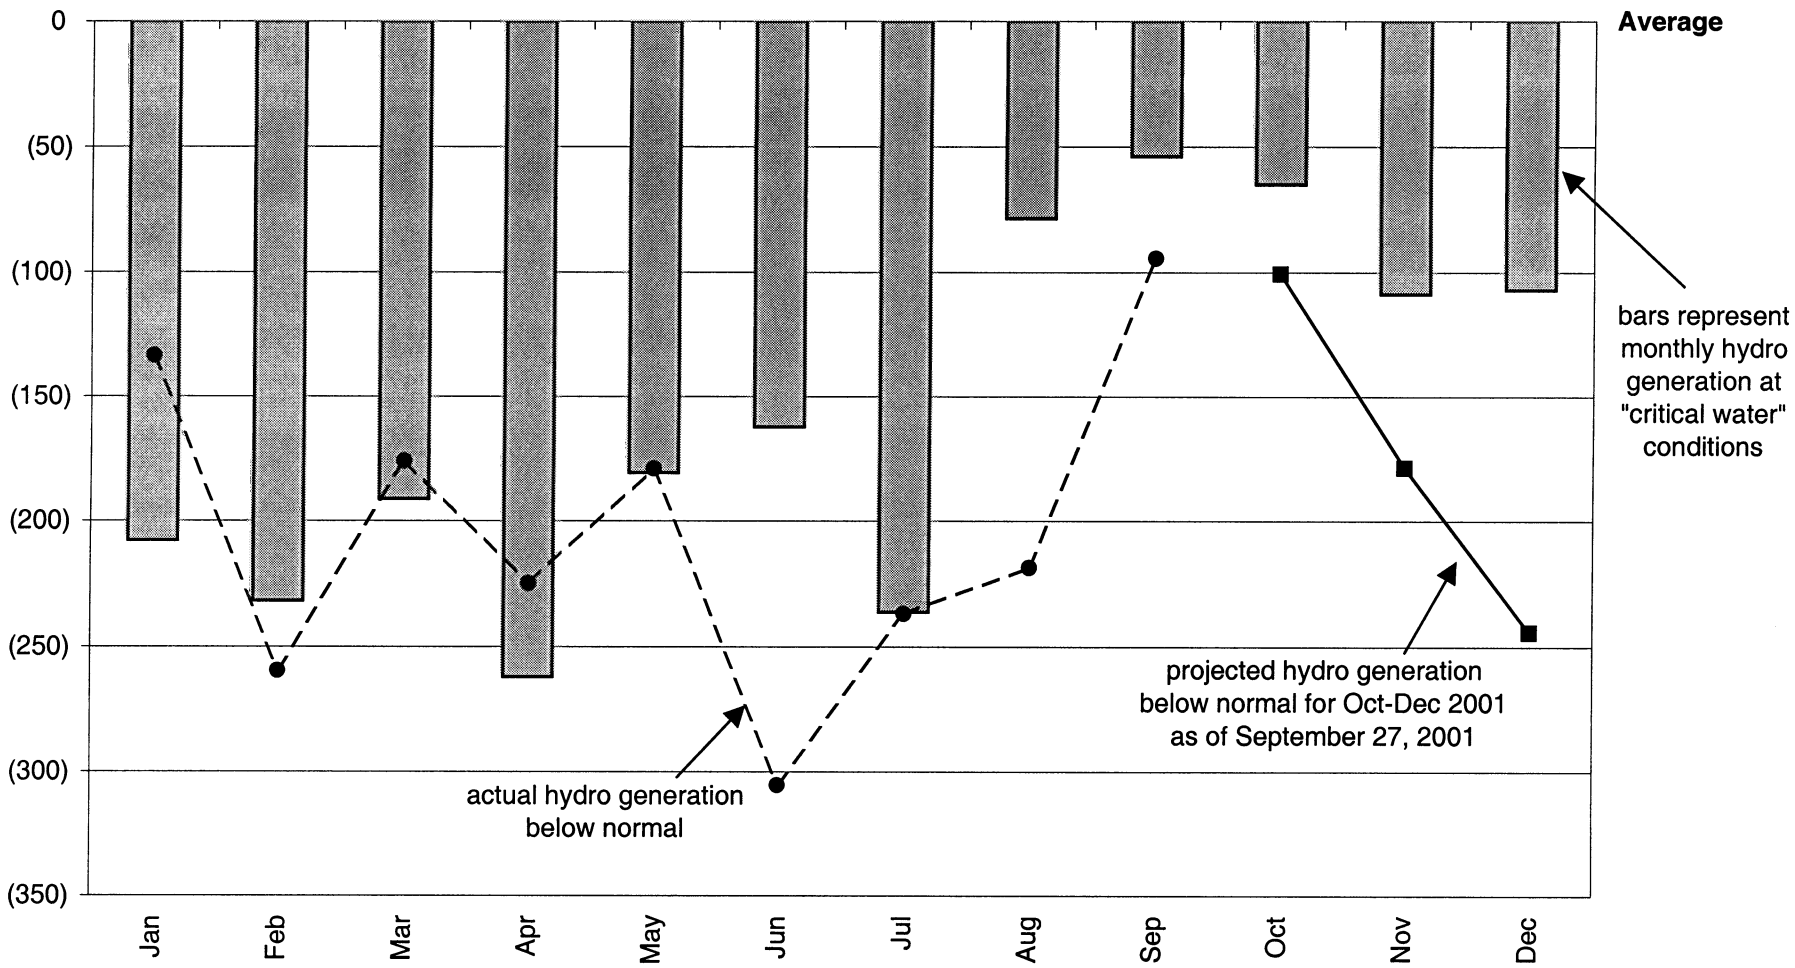

AVISTA UTILITIES

1929 - 2001 Avista System and Mid-Columbia Hydro Generation
Variation from Average

(aMW by Calendar Year)

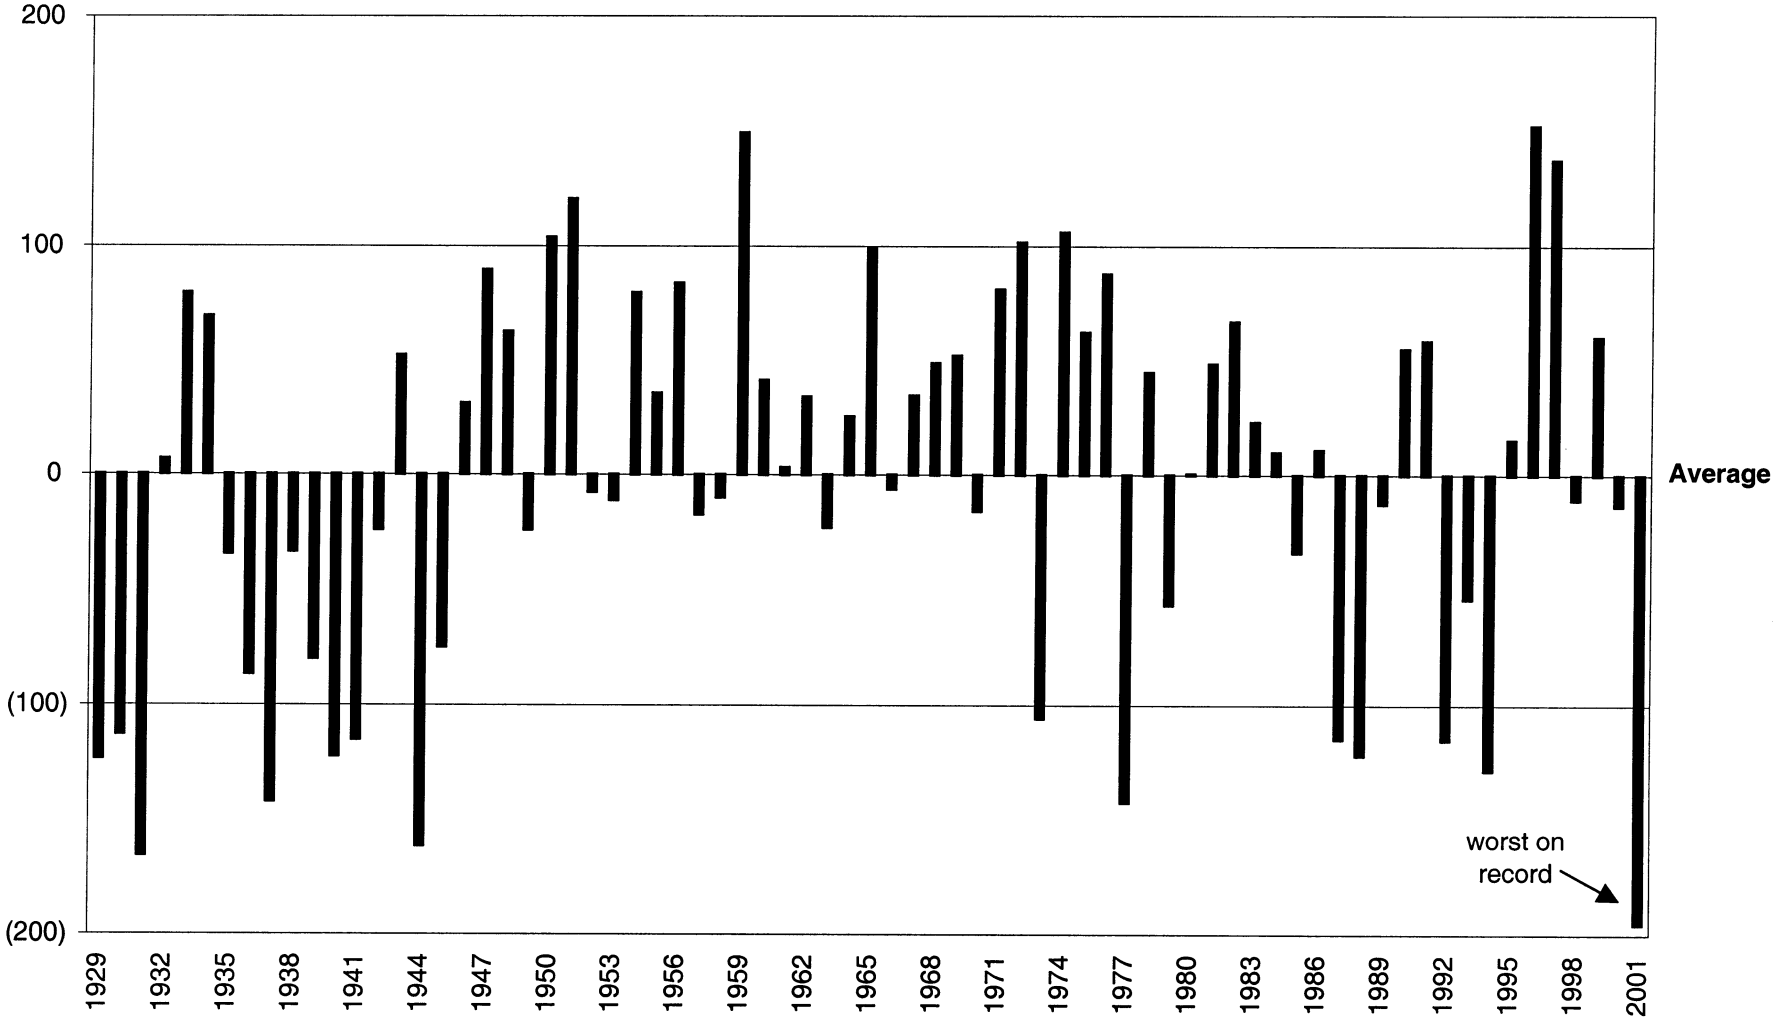

1929 - July 1988 is modeled generation based on the 2000-2001 NWPP Hydro Regulation.
August 1988 - September 2001 is actual generation.
October 2001 - December 2001 is forecasted generation.

AVISTA UTILITIES
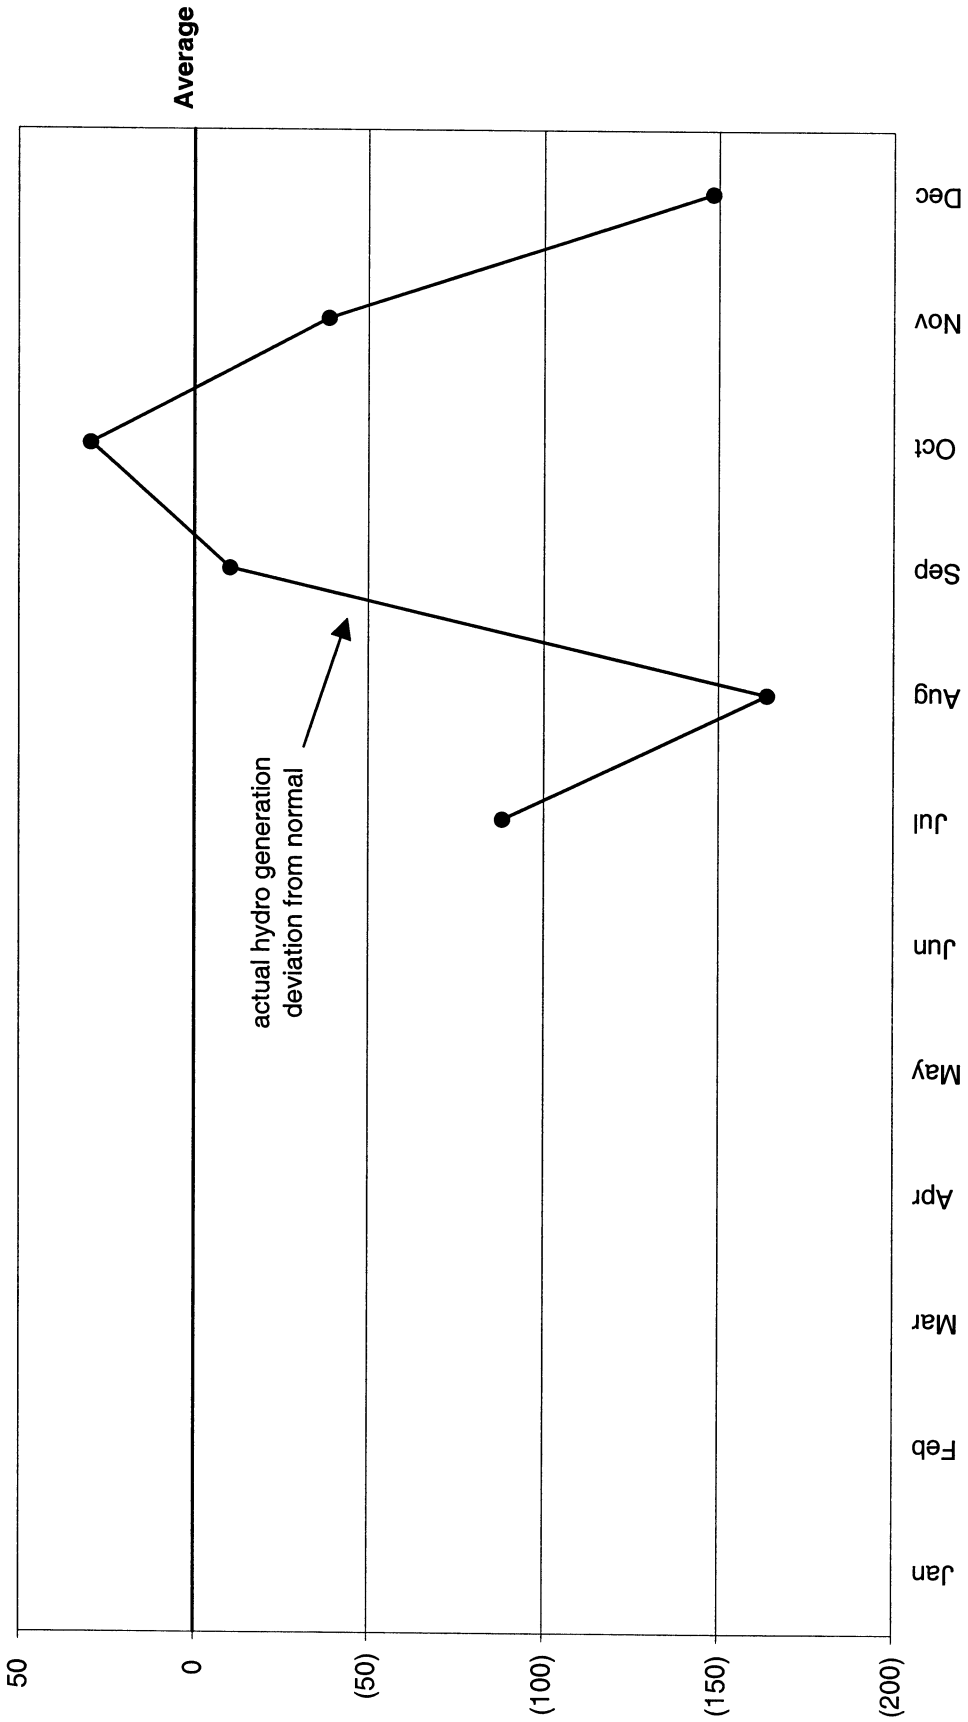
2000 Avista System and Mid-Columbia Actual Hydro Generation
Deviation from Normal
(aMW by Month)