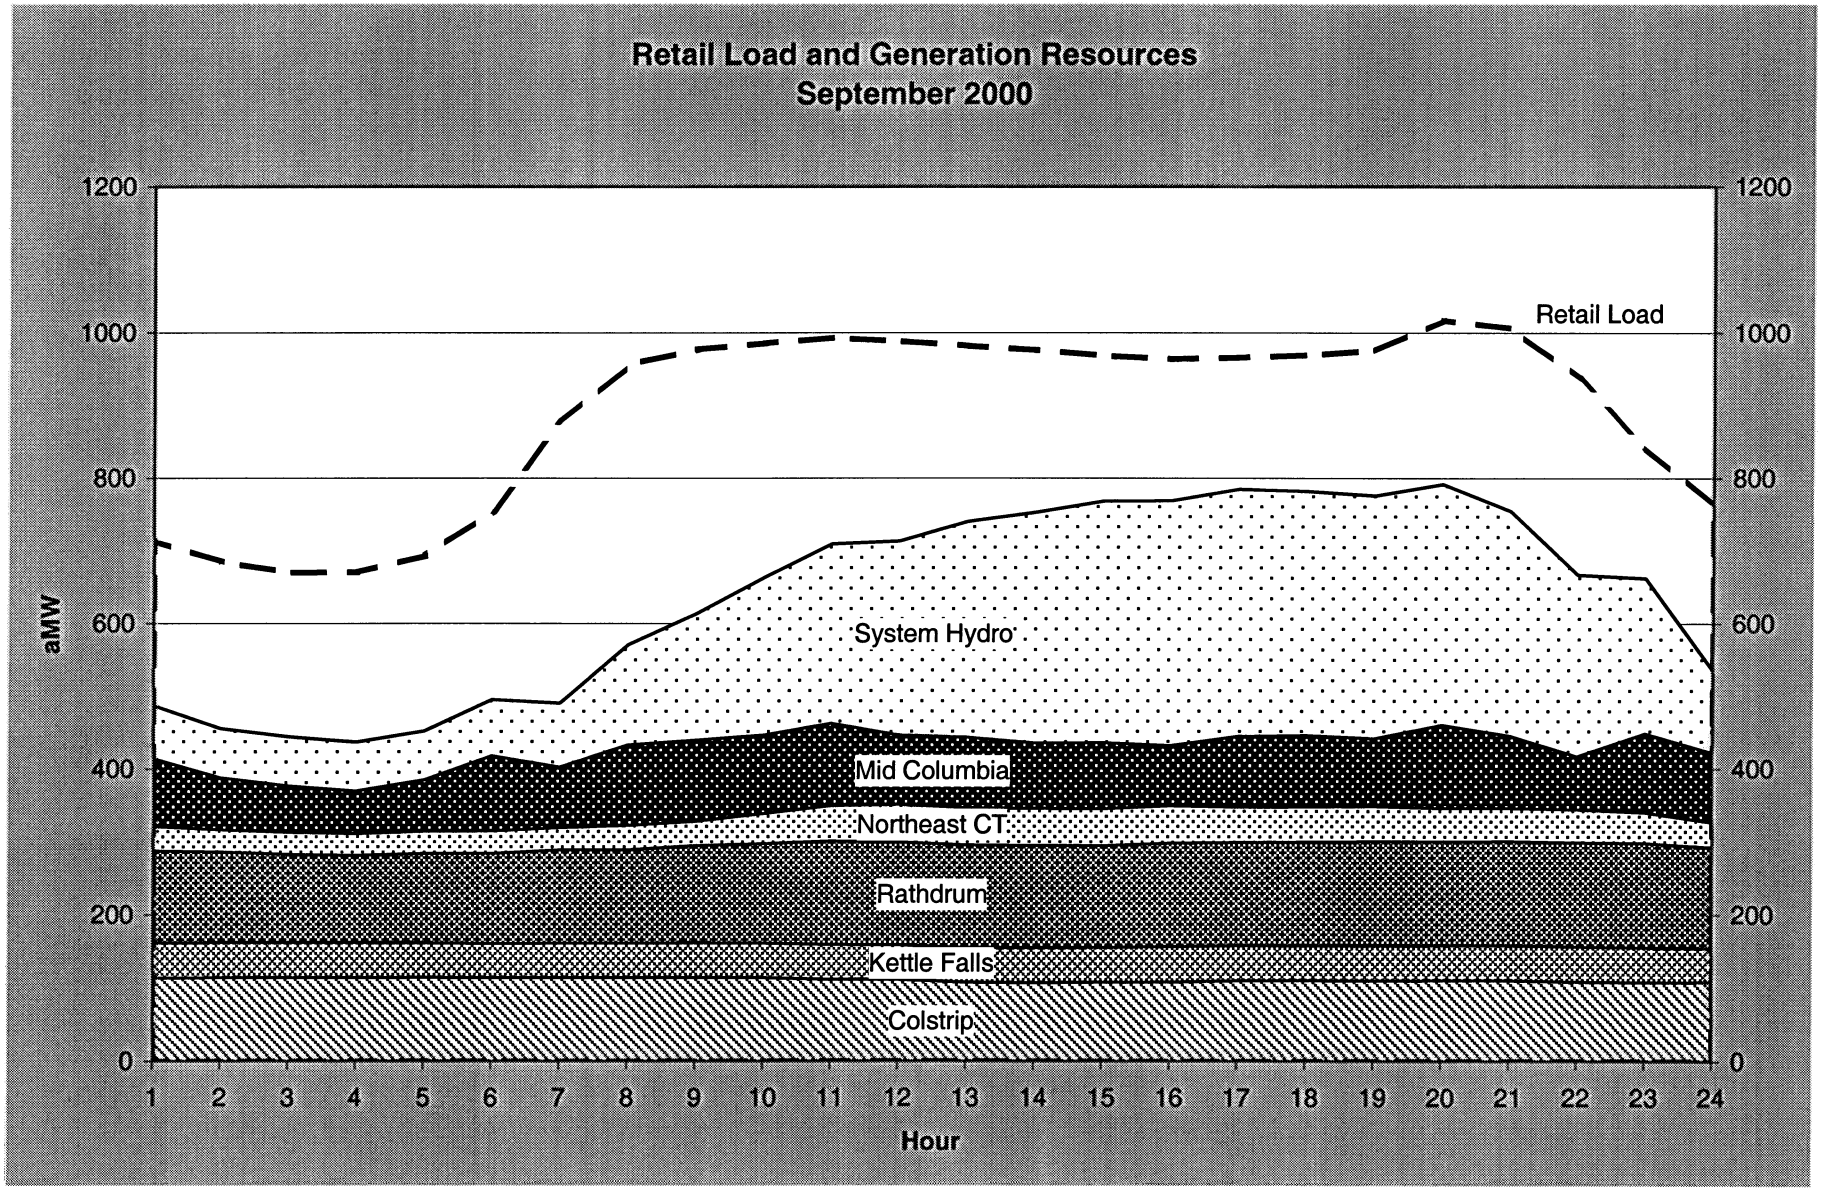
Retail Load and Generation Resources
September 2000
aMW
1200
1000
800
600
400
200
0
Retail Load
System Hydro
Mid Columbia
Northeast CT
Rathdrum
Kettle Falls
Colstrip
1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22 23 24
Hour

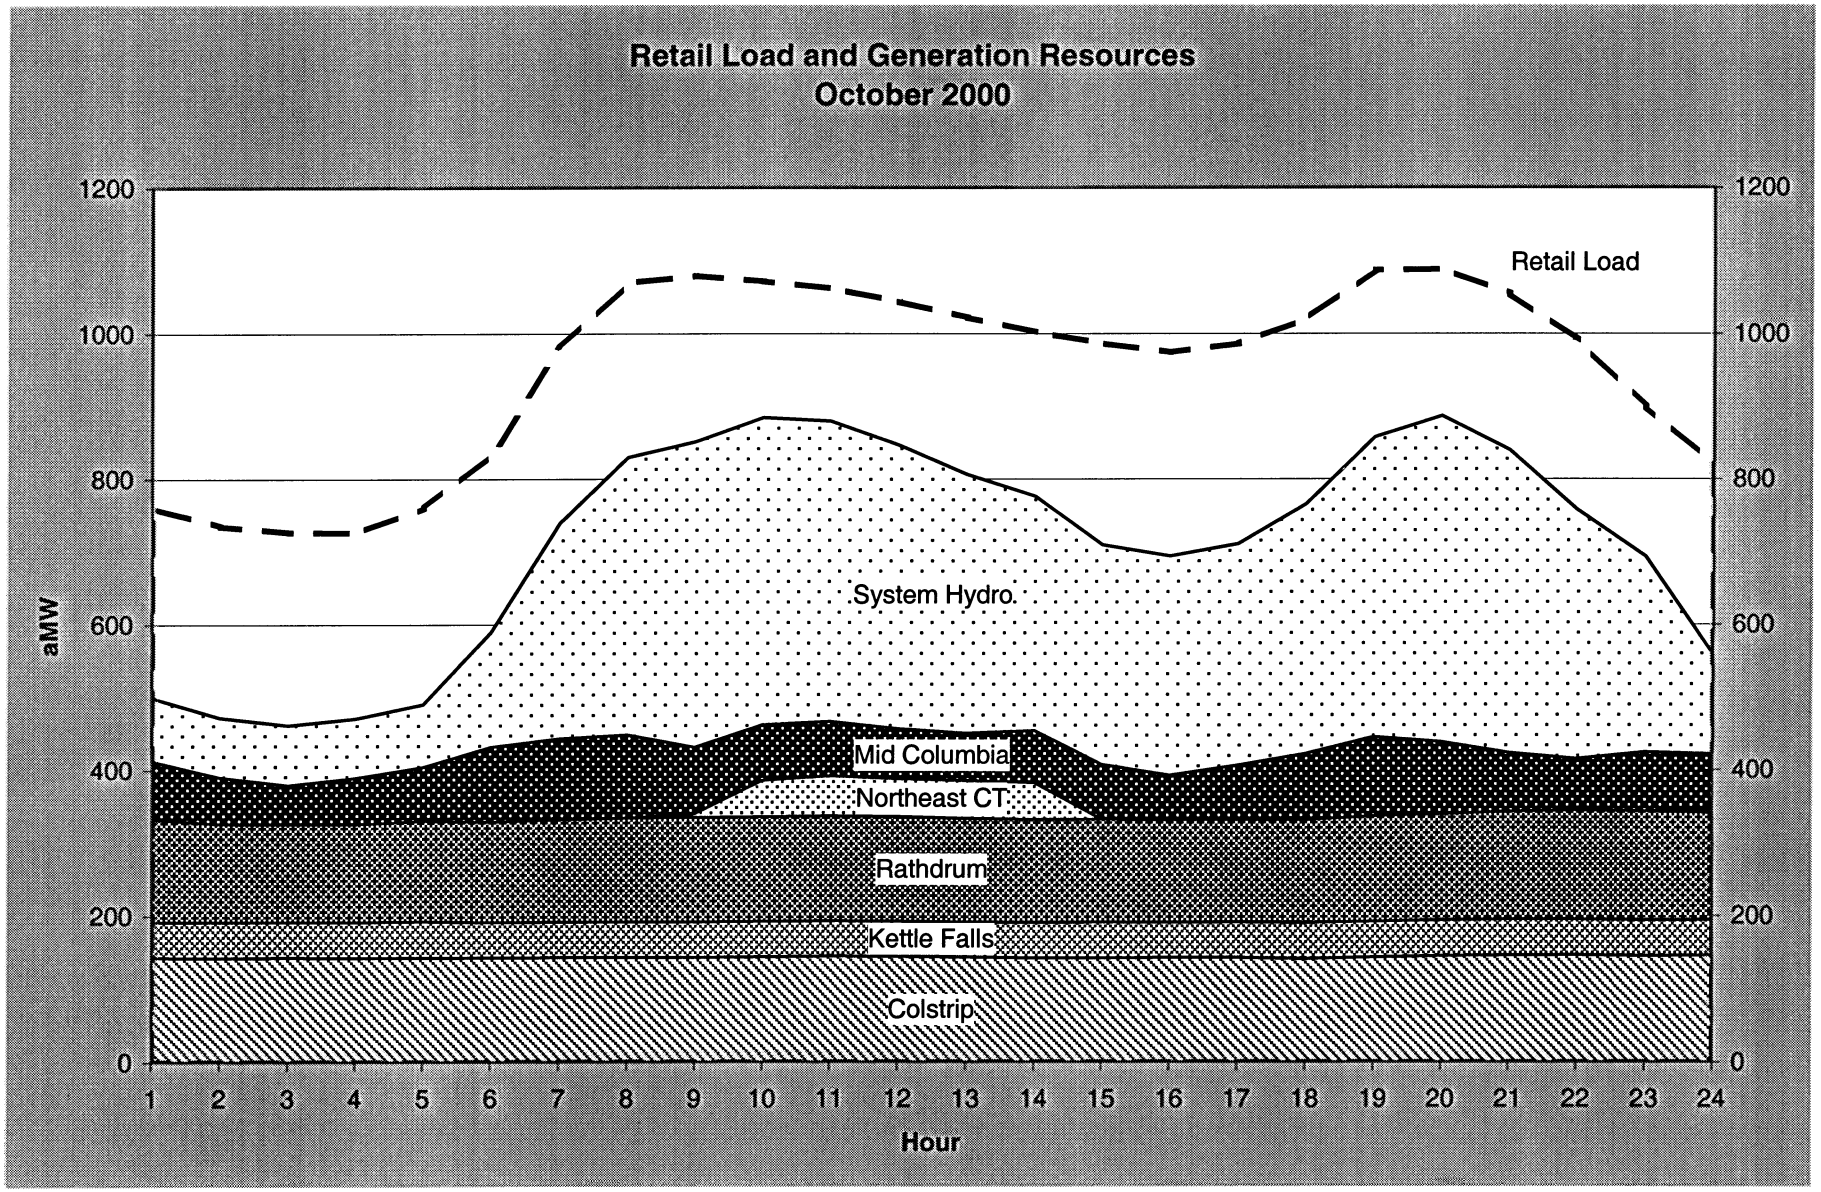

Exhibit No. _____ (WGJ-8)
Docket No. UE-_____
Johnson, Avista
Page 4 of 15